

591-119
DRAWING NUMBER
A-105

DRAWING NUMBER 1

DRAWING NUMBER 2

DRAWING NUMBER



M-2 #1 1-1-80

H.S.C. VENTILATION INDEX (NEW CODE)									
ROOM	AREA 10	VOLUME	NO. OF PEOPLE	VENTILATION INDEX	REQ'D CFM	EXHAUST	PERMIT CFM	SUPPLY	EXHAUST
RENT TRADING RM	6685	5031	21	583	587	587	583	583	583


AC-9 IS A RECIRCULATING AIR CONDITIONING SYSTEM MIN. OUTSIDE AIR EQUALS TO 25/3% REQ'D AIR FOR BUILDING INTERIOR + INDUCTION UNIT AIR SUPPLY.

LEGEND


- EXIST. PLTWORK
- NEW PLTWORK
- |||| EXIST. DOUBLE POUGH
- |||| EXIST. DOUBLE POUGH - REMOVE
- |||| NEW OR RELOCATED DOUBLE POUGH
- ~ 7" FLEXIBLE CONNECTION - NEW OR RELOCATED
- ☒ CEILING DIFFUSER
- + VD VOLUME DAMPER
- AC UNIT AIR CONDITIONING UNIT
- (CC) NO. OF CFM - BALANCE
- ACWS AUXILIARY COOLING WATER - SUPPLY
- ACWR AUXILIARY COOLING WATER - RETURN
- |||| EXIST. FULL CAPACITY INDUCTION UNIT
- |||| EXIST. FULL CAPACITY INDUCTION UNIT OPERATING @ HALF CAPACITY
- |||| EXIST. ONE & ONE HALF CAPACITY INDUCTION UNIT
- CEF CEILING EXHAUST FAN

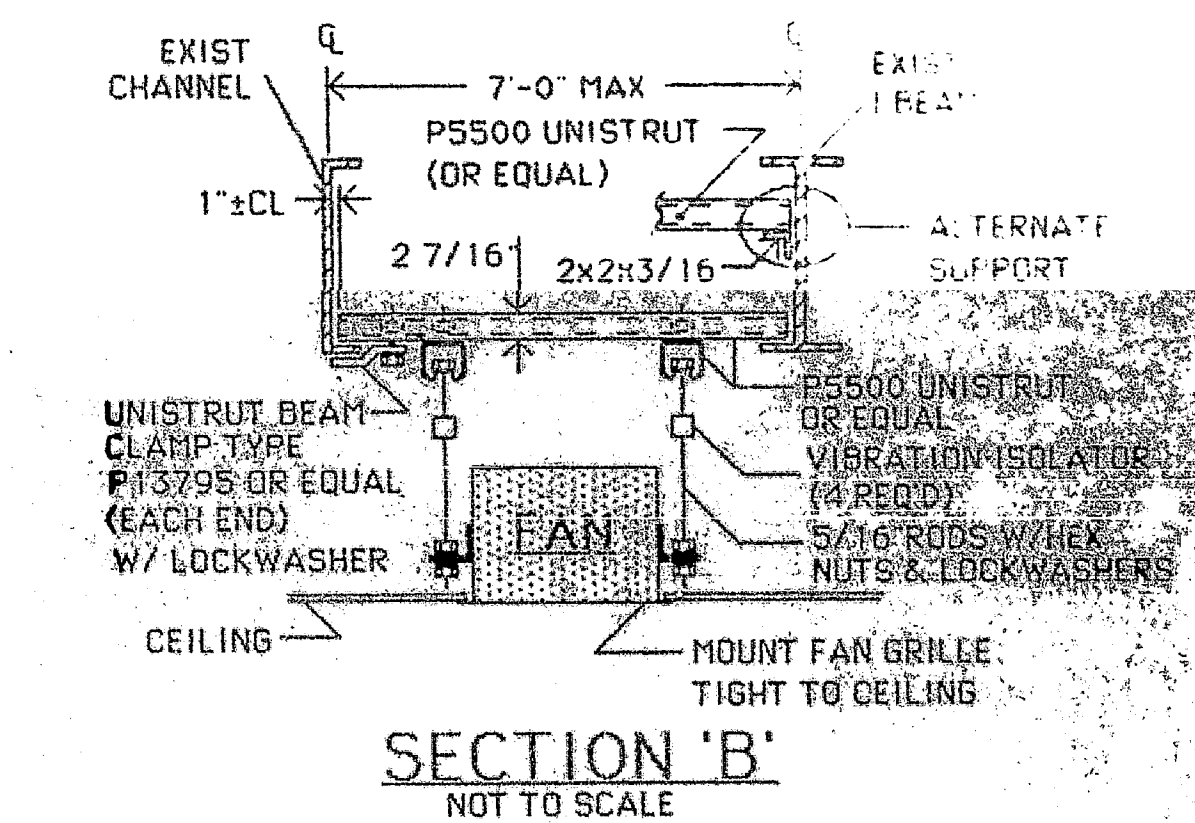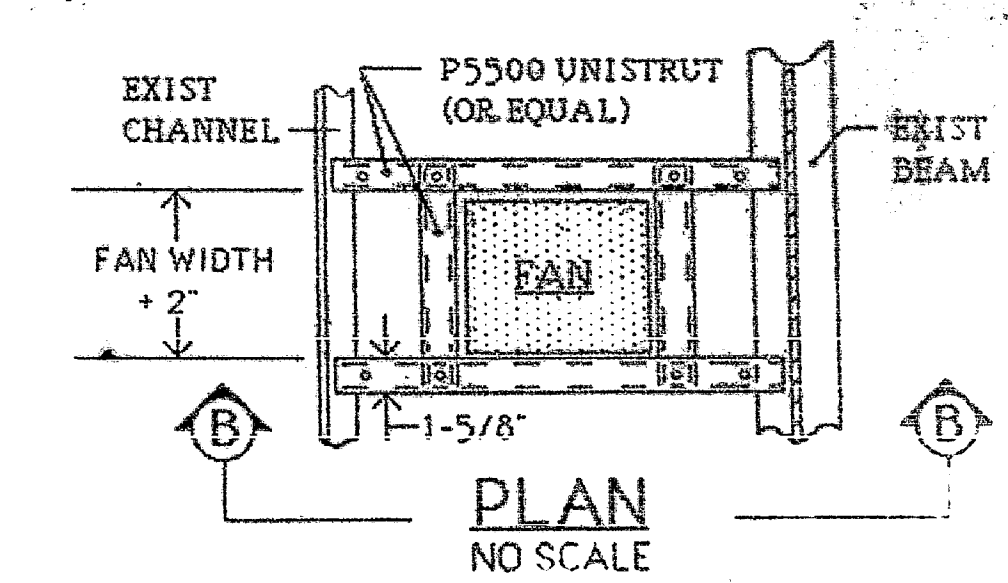

FAN HANGING DETAIL CEF #1

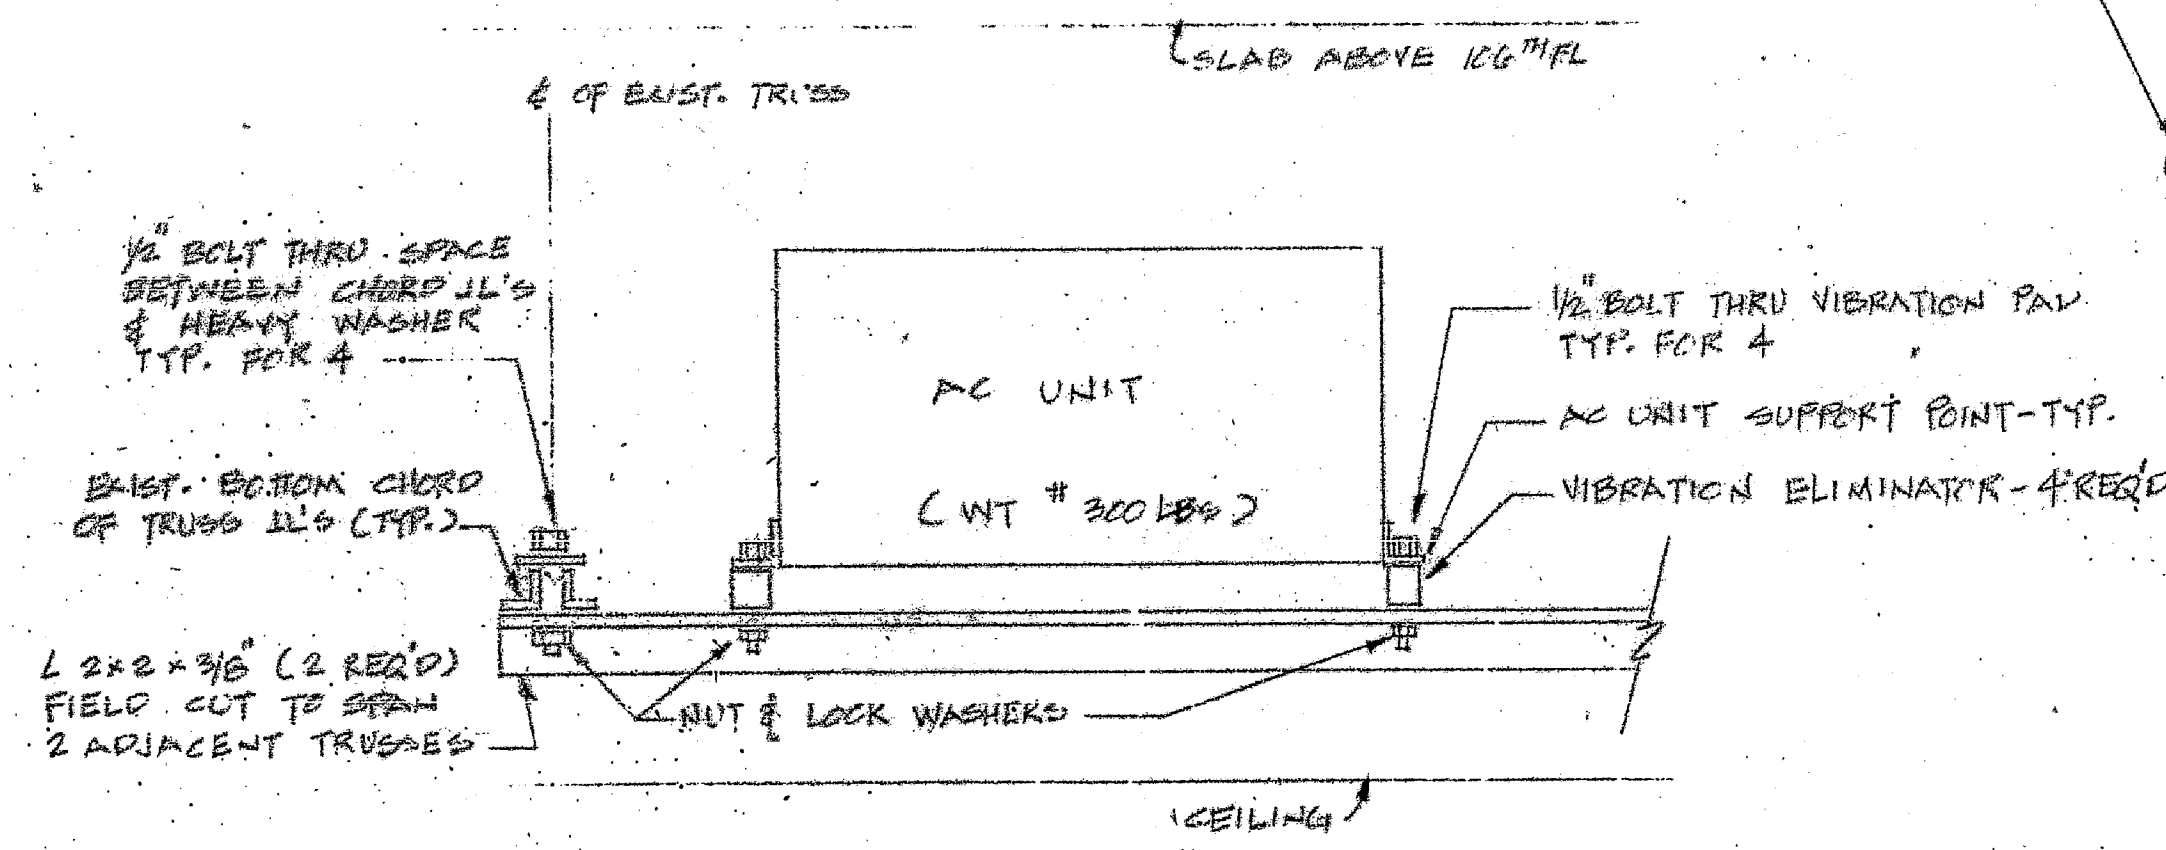

A.C. UNIT HANGING DETAIL NO SCALE

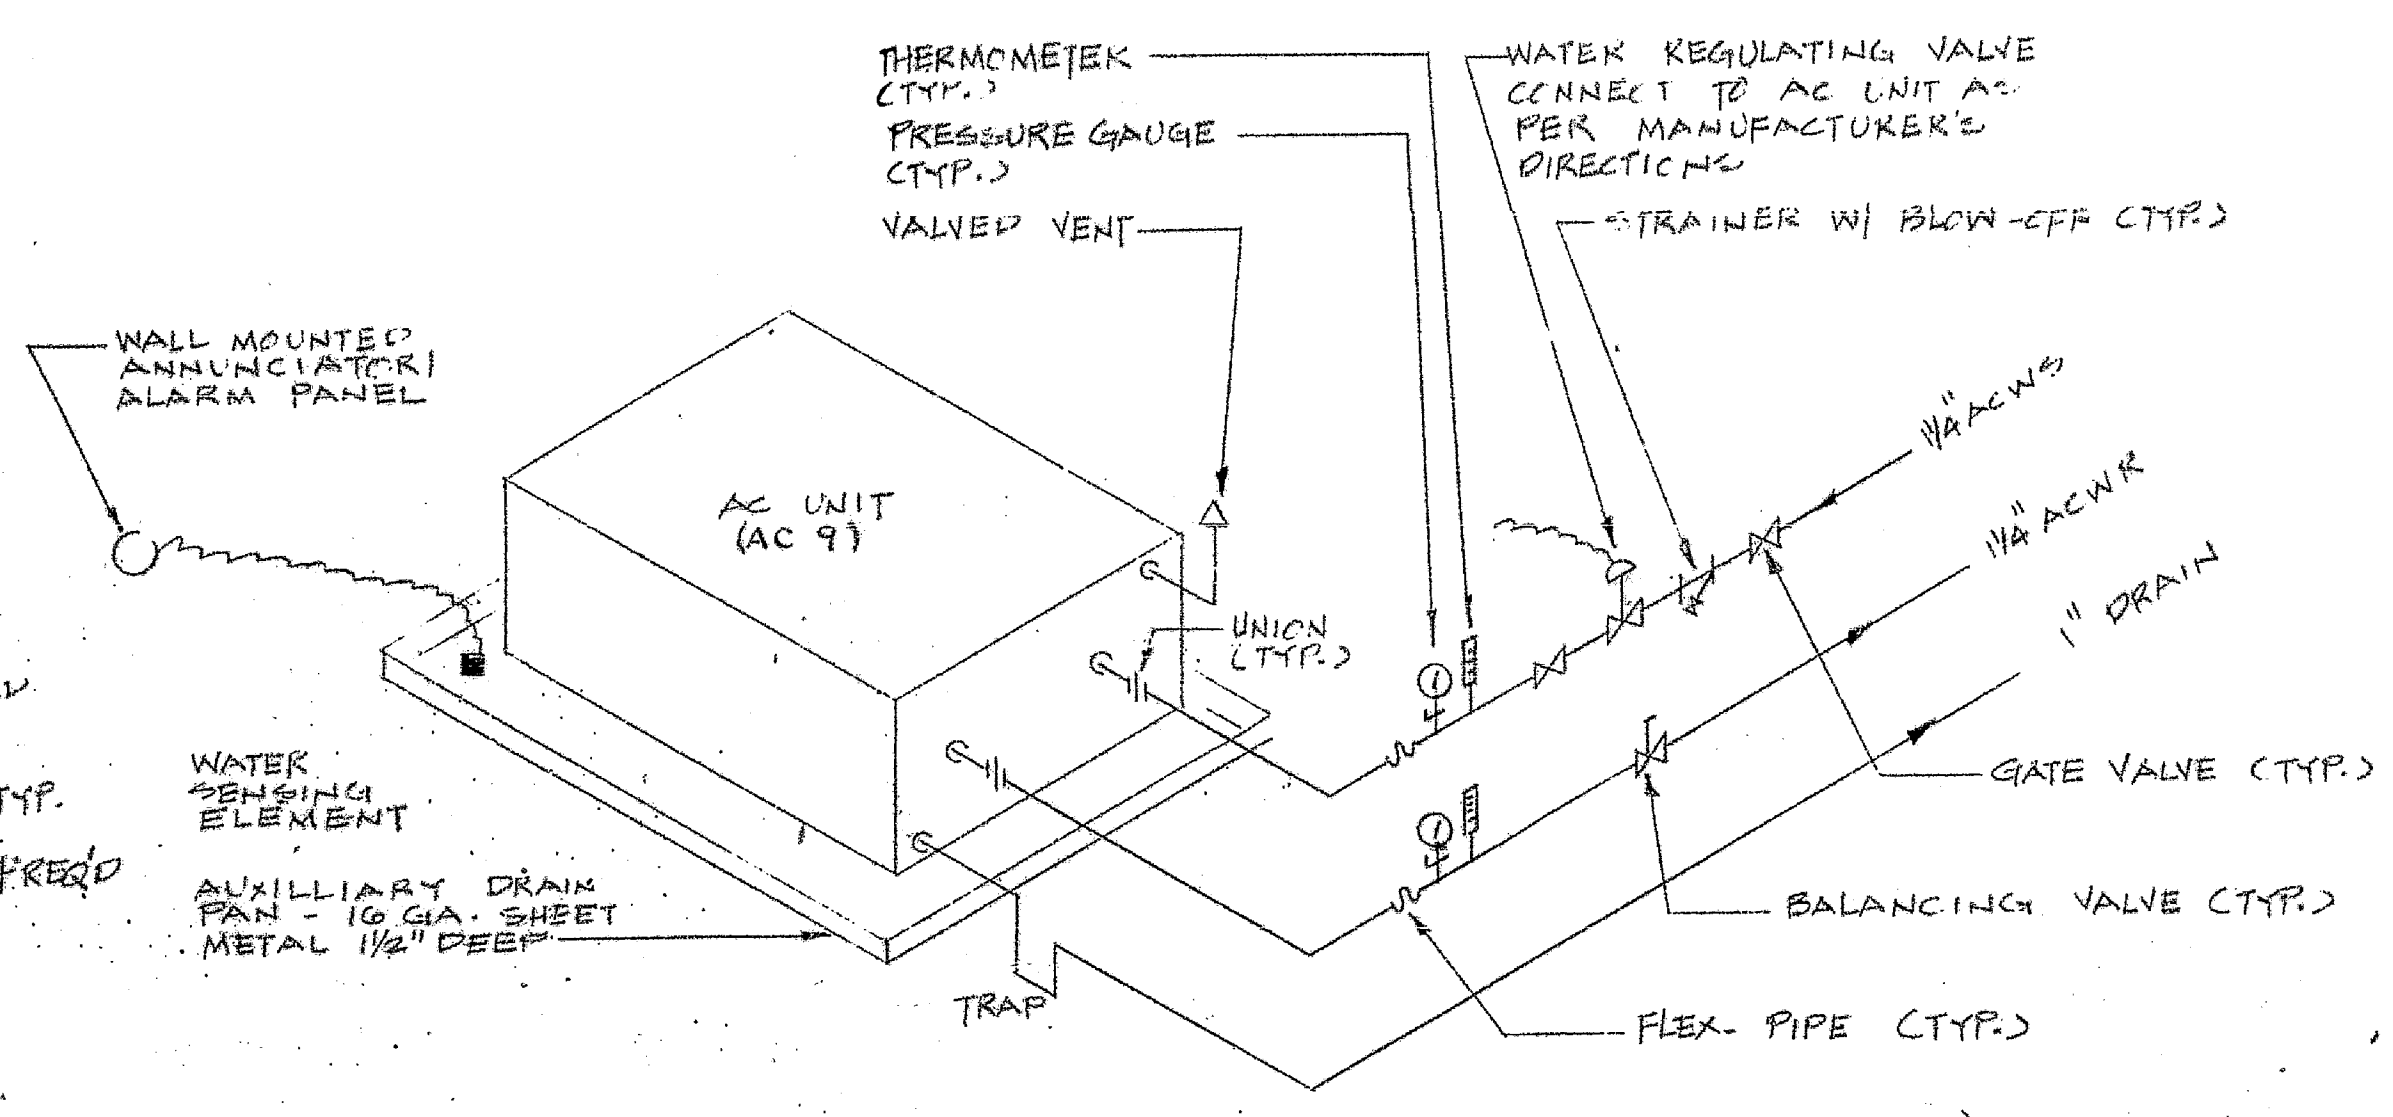

A.C. UNIT PIPING SCHEMATIC NO SCALE

TCA/TAA NO. 3104
CONTRACT NO. 591.1
DATE APPROVED 11-8



REV	DATE	AS PER COMMENTS
REV 1	1-16-85	AS PER COMMENTS
NEW CORPORATE BOND TRADING		
CANTOR FITZGERALD SECURITIES CO.		
ONE WORLD TRADE CENTER FLOOR 1000		
NEW YORK, N.Y. 10048		
MECHANICAL LEGEND & NOTES		
JOHN C. WESTRICK & ASSOCIATES		
CONSULTING ENGINEERS		
2110 MAPLE AVENUE		
SOUTH PLAINFIELD, N.J. 07080		